HIGH FLOW BYPASS PIT PHOTO

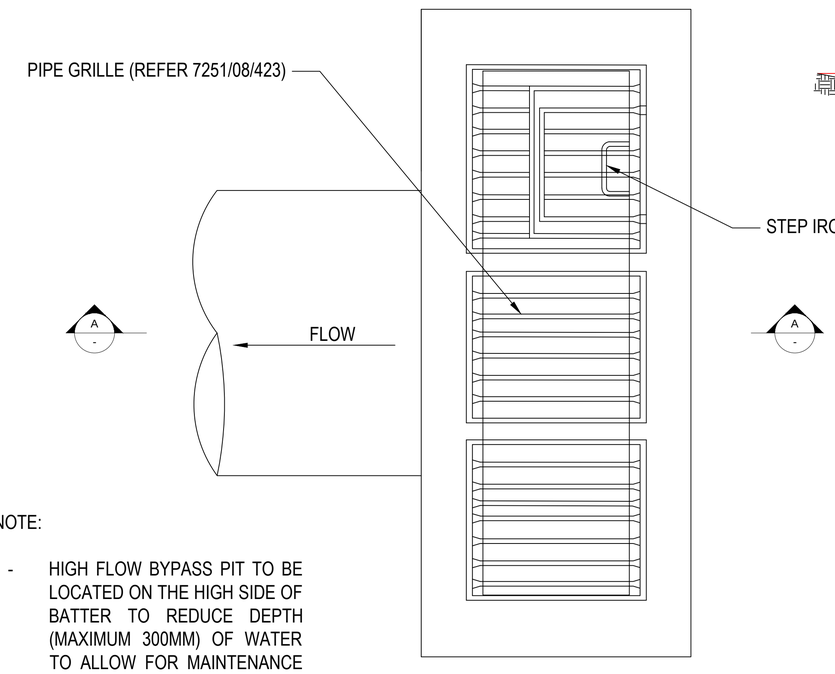

NOTE:

- HIGH FLOW BYPASS PIT TO BE LOCATED ON THE HIGH SIDE OF BATTER TO REDUCE DEPTH (MAXIMUM 300MM) OF WATER TO ALLOW FOR MAINTENANCE ACCESS

HIGH FLOW BYPASS PIT PLAN VIEW

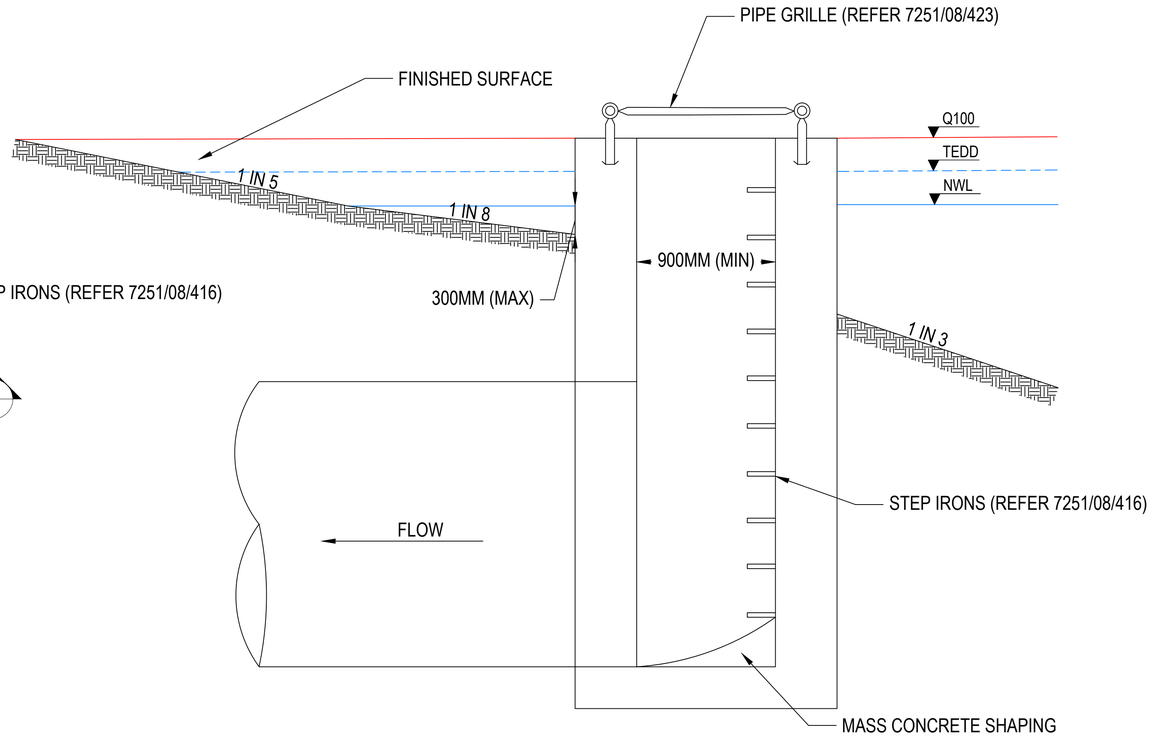

HIGH FLOW BYPASS PIT SECTION A-A

CONCEPT ONLY NOT TO SCALE

REV	DESCRIPTION	COMPANY	PROJECT OR WO NUMBER	DRAWN	ENG. CHECK	PR. MAN. APP'D	DATE

Melbourne Water

DRAFTER	DESIGNER	DESIGN MANAGER APPROVAL	PROJECT MANAGER APPROVAL
DRAFTING CHECK	ENGINEERING REVIEW		

TITLE
OUTFALL EXAMPLE TYPE 2
HIGH FLOW BYPASS PIT
SHEET 2 OF 2

PROJECT DATUM	Original Size	MELBOURNE WATER CORPORATION
SCALE		CODE: — MWC DRAWING NUMBER: 7251/12/4004 — REV: