NOTE:

- ALTERNATE APPROACH WETLAND.
- ONLINE SYSTEM.
- BOTH THE HIGH AND LOW FLOWS PASS THROUGH THE SYSTEM.
- WITHOUT COMBINED EDD CONTROL AN ADJUSTABLE EDD ISN'T POSSIBLE. FOR EXAMPLE THE EDD CAN'T BE BYPASSED FOR THE FIRST 12 MONTHS OF THE PLANTING ESTABLISHMENT.
- FULL GRAVITY DRAWDOWN IS PROVIDED VIA BALANCE PIPES AND THE TWIN CHAMBER OUTFALL PIT WHICH CONTAINS A GATE VALVE.

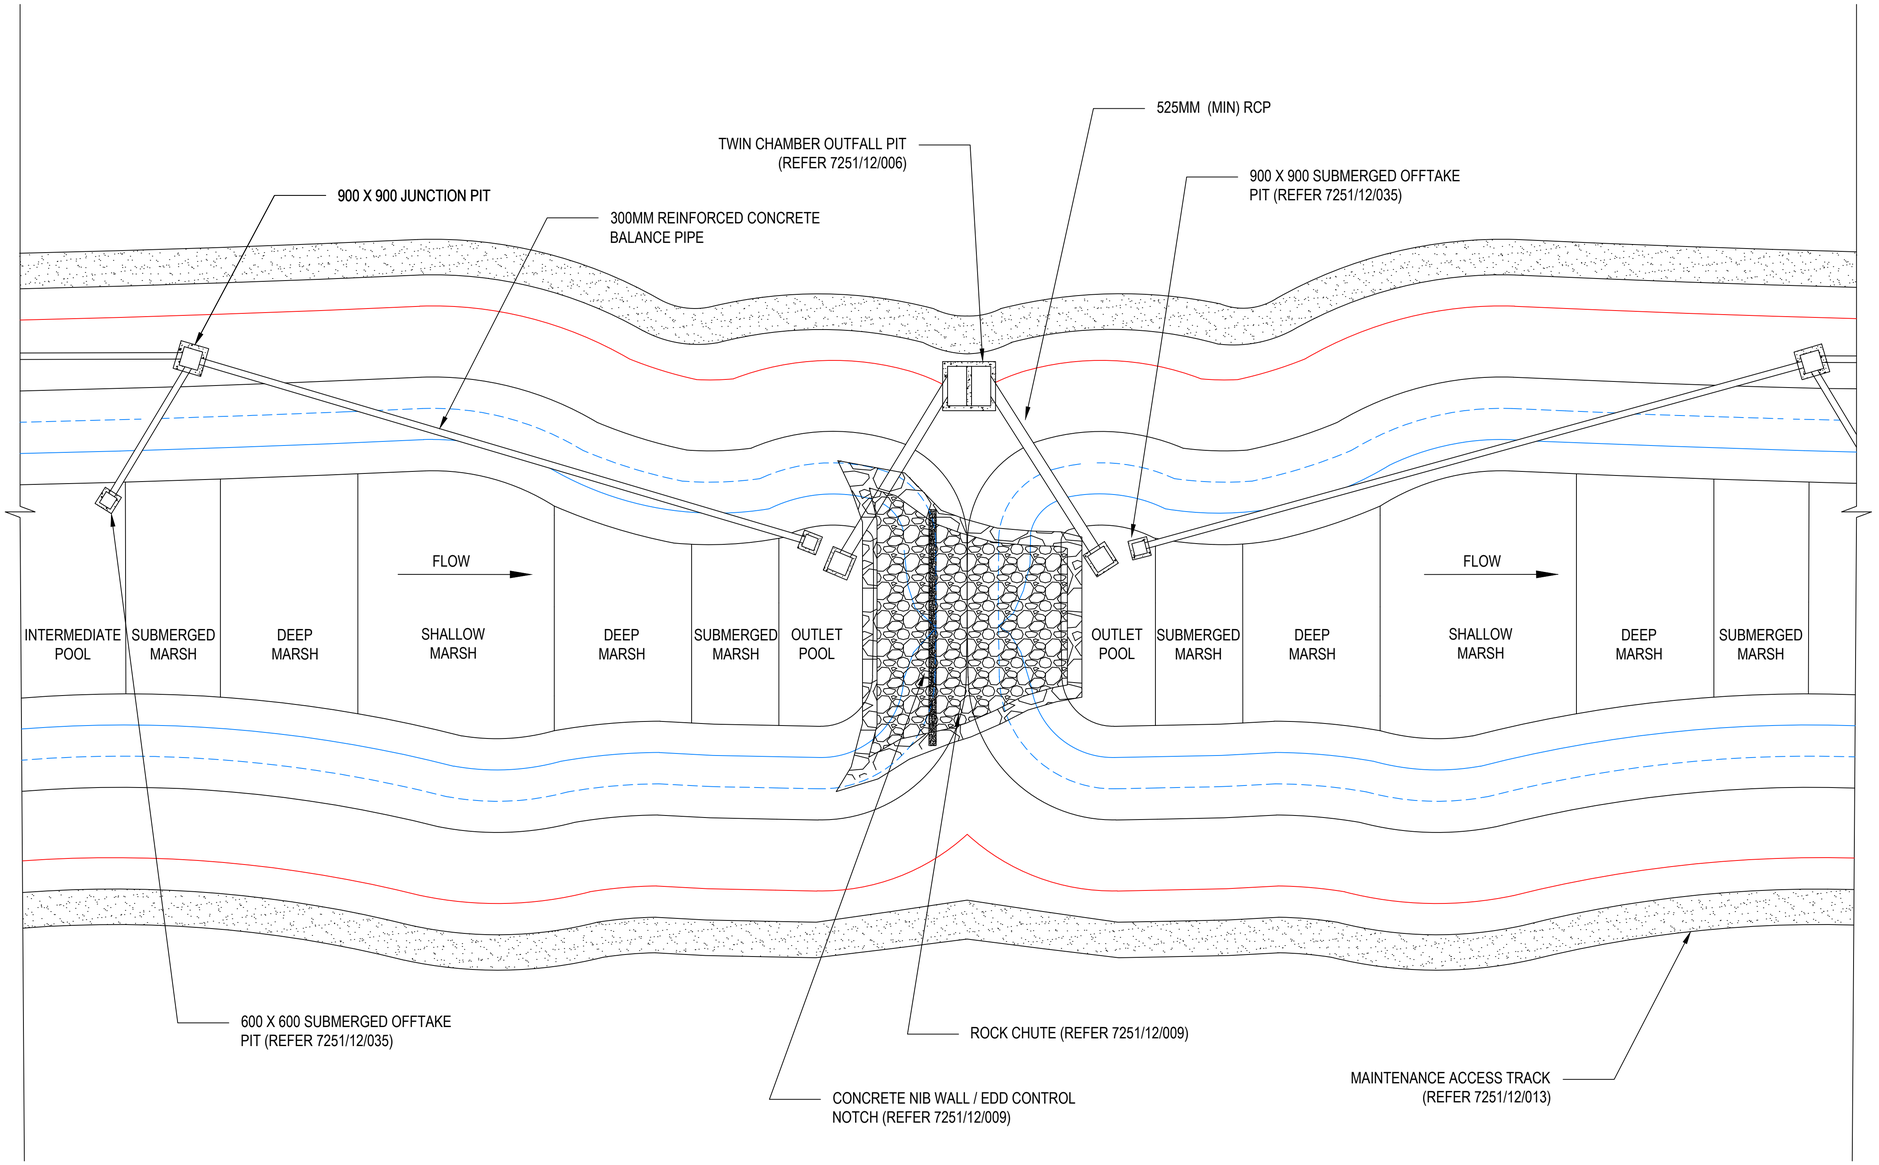

LEGEND

NWL

TEDD

Q100

PLAN VIEW

CONCEPT ONLY
NOT TO SCALE

REV	DESCRIPTION	COMPANY	PROJECT OR WO NUMBER	DRAWN	ENG. CHECK	PR. MAN. APP'D	DATE

Melbourne Water

DRAFTER	DESIGNER	DESIGN MANAGER APPROVAL	PROJECT MANAGER APPROVAL
DRAFTING CHECK	ENGINEERING REVIEW		

TITLE
OUTFALL EXAMPLE TYPE 5
EDD CONTROL ROCK CHUTE AND TWIN CHAMBER OUTFALL PIT (PLAN VIEW)
SHEET 1 OF 1

PROJECT DATUM | Original Size | MELBOURNE WATER CORPORATION

SCALE

CODE | MWC DRAWING NUMBER 7251/12/4010 | REV